


**CUT-IN-TEE**

(ONLY BY APPROVAL OF THE ENGINEER)

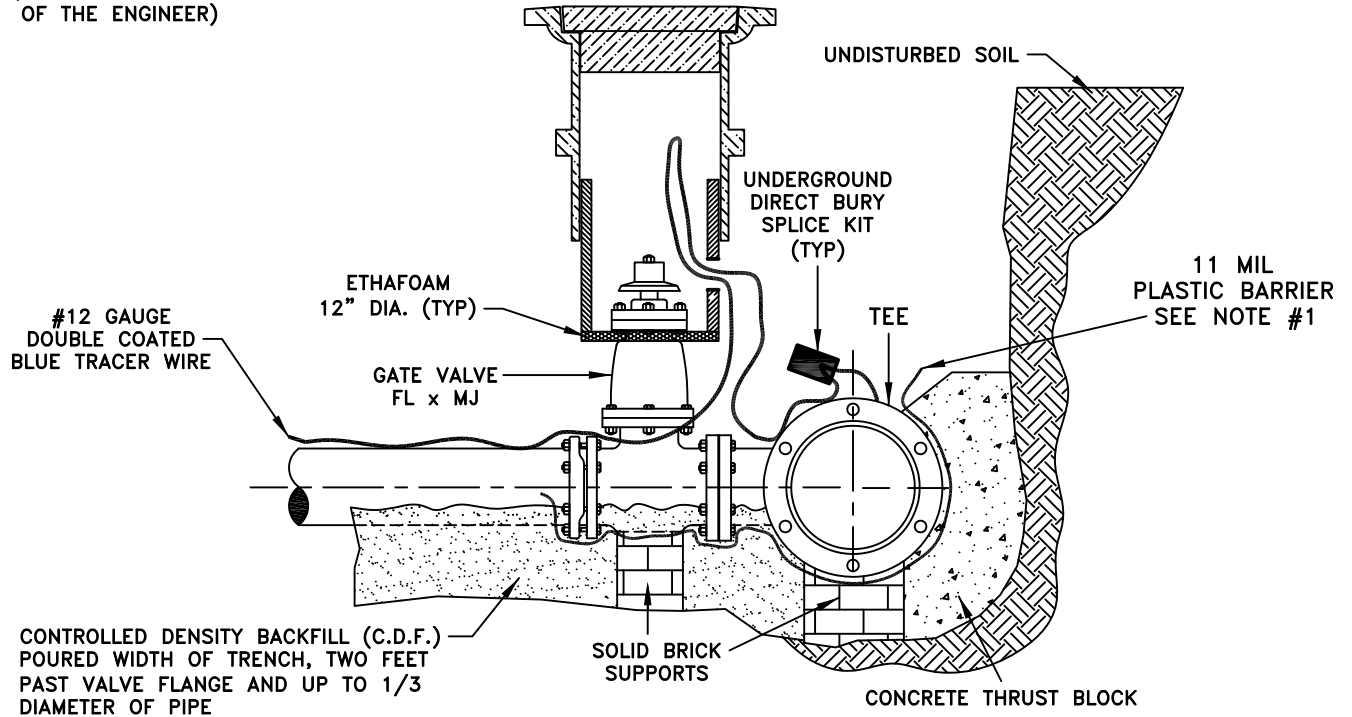

**GENERAL NOTES:**

1. 11 MIL PLASTIC SHALL BE WRAPPED AROUND PIPE AND FITTINGS BEFORE THRUST BLOCK AND BACKFILL ARE POURED.
2. CONTROLLED DENSITY BACKFILL IS A PLANT MIX CONSISTING OF 1750# SAND, 1750# PEA GRAVEL, 230# WATER, 141# CEMENT, 6 OUNCES WATER REDUCING AGENT PER 100# CEMENT.
3. SUPPORT VALVE AND SLEEVE CONTINUOUSLY THROUGH INSTALLATION.
4. MINIMUM 96 HOURS NOTICE SHALL BE GIVEN TO THE CITY BEFORE SCHEDULED CONNECTION TO THE EXISTING WATER LINE.

CITY OF TUMWATER, WASHINGTON DEPT. OF PUBLIC WORKS				
<b>CUT-IN TEE</b>				
APPROVED BY:				DWG. NO.
CITY ENGINEER				<b>WA-11</b>
DES. PW	DWG. BY PW	CK'D BY KMC	DATE JUNE 2014	NOT TO SCALE