


PLASTIC READER LID
(SEE NOTE #8)

CARSON 1220-12 METER BOX W/PLASTIC READER LID (OR EQUAL). METER PROVIDED BY CITY OF TUMWATER.

WATER SERVICE MARKER STAKES
SEE CITY DETAIL

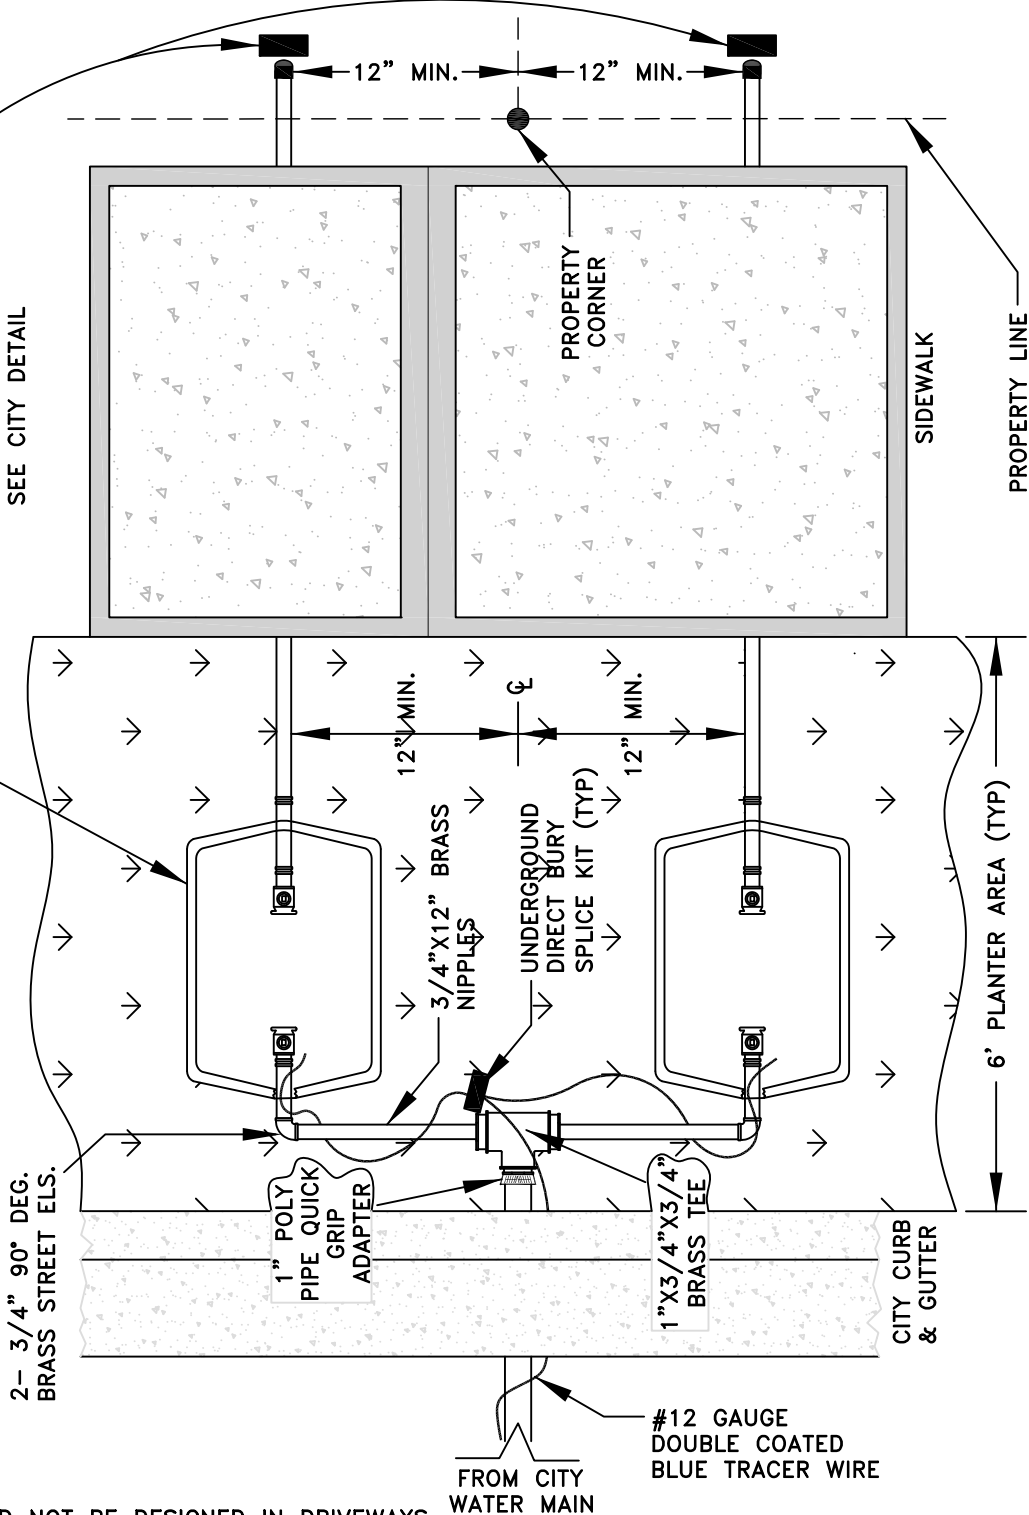

GENERAL NOTES:

1. METER BOXES SHOULD NOT BE DESIGNED IN DRIVEWAYS, DRIVEWAY APPROACHES, SIDEWALKS OR CONFLICTED AREAS. WHEN POSSIBLE CREATE PLANTER AREAS FOR METER BOX INSTALLATION.
2. STAINLESS STEEL INSERTS ARE REQUIRED FOR ALL PACK JOINTS AND GRIP TIGHT ADAPTERS.
3. ALL SERVICE SADDLES SHALL HAVE RUBBER GASKETS AND I.P. THREADS.
4. GALVANIZED PIPES AND FITTINGS BETWEEN WATER METER AND BACKFLOW ASSEMBLY ARE NOT ALLOWED.
5. SERVICE CLAMPS SHALL BE STAINLESS STEEL, DOUBLE STRAP. DIRECT TAPS ARE NOT ALLOWED.
6. DOUBLE INSULATED 12 GAUGE BLUE COATED COPPER U.S.E. TONING WIRE SPLICED TO MAINLINE TRACER WIRE ON ALL SERVICE LINES.
7. ALL SERVICE LINE FITTINGS SHALL BE BRASS.
8. IF METERS ARE LOCATED IN DRIVEWAY OR SIDEWALK, THEY MUST BE BOXED OUT WITH MASTIC JOINTS OR SCRIBE MARKS AND HAVE A TRAFFIC RATED LID.

CITY OF TUMWATER, WASHINGTON DEPT. OF PUBLIC WORKS				
3/4" DOUBLE WATER METER SERVICE				
APPROVED BY:				DWG. NO.
CITY ENGINEER				WA-22
DES. PW	DWG. BY PW	CK'D BY KMC	DATE JULY 2014	NOT TO SCALE