


BEDDING 6" BELOW CONDUIT BACKFILL WITHIN 10" OF FINISH GRADE

SCH. 40 CONDUIT

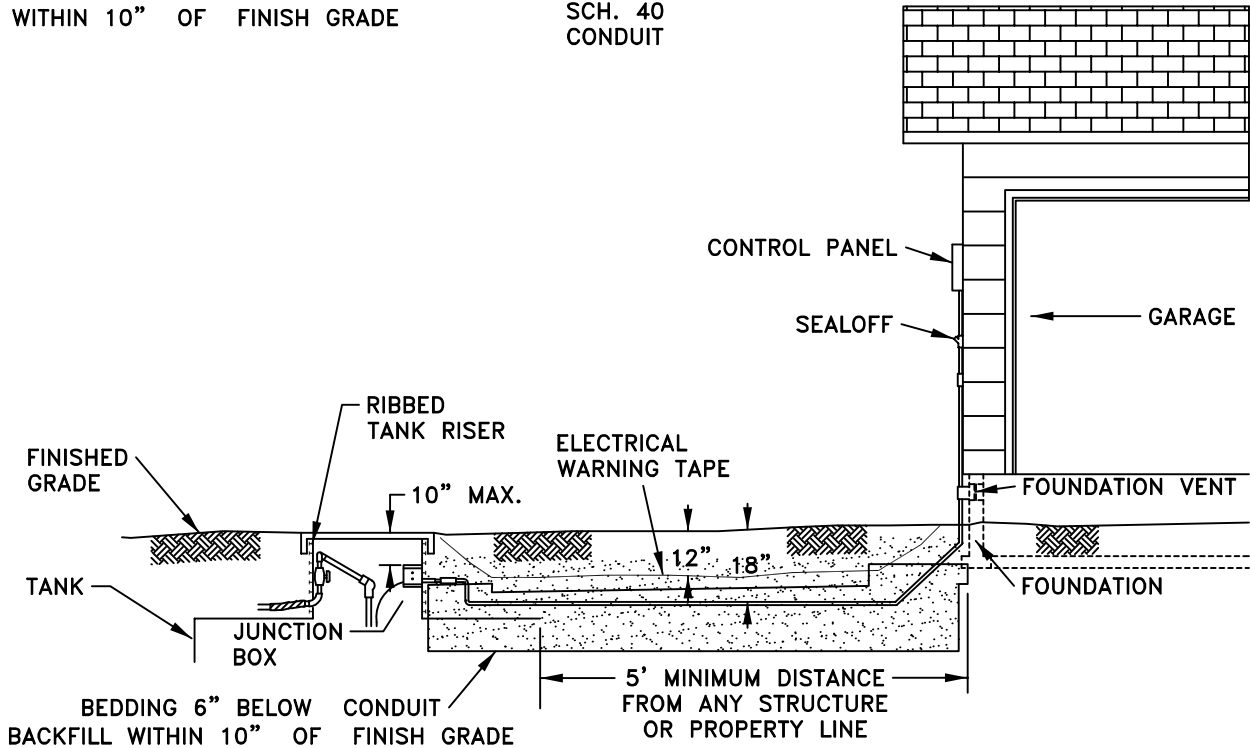

BEDDING 6" BELOW CONDUIT BACKFILL WITHIN 10" OF FINISH GRADE

5' MINIMUM DISTANCE FROM ANY STRUCTURE OR PROPERTY LINE

**GENERAL NOTES:**

1. CONTROL PANEL REQUIREMENT ARE IN 7E.095 PAGE 7-62.
2. ELECTRICAL CONDUIT MUST BE BEDDED IN SAND.
3. STEP LINES UNDER DRIVEWAYS SHALL BE CASED IN 2" CLASS 200 PVC EXTENDED 2 FEET BEYOND THE DRIVEWAY EDGES.
4. IN THE COUNTY A SQUARE D 30A 240 VAC 3R SAFETY SWITCH NON-FUSED IS REQUIRED.

CITY OF TUMWATER, WASHINGTON  
DEPT. OF PUBLIC WORKS

**S.T.E.P. CONTROL  
PANEL DETAIL**

APPROVED

DWG. NO.

CITY ENGINEER

**SS-19**

DES.  
PW

DWG. BY  
PW

CK'D BY  
KMC

DATE  
JAN. 2012

NOT TO  
SCALE